


NOTE:
 GALVANIZED UNIONS NOT NECESSARY ON ABOVE 2" SIZE UNITS WHERE FLANGED PIPE FITTINGS ARE USED. ON 2" OR SMALLER BACKFLOW DEVICES MAY HAVE FLANGED FITTINGS. IN THAT CASE, UNIONS ARE NOT REQUIRED.

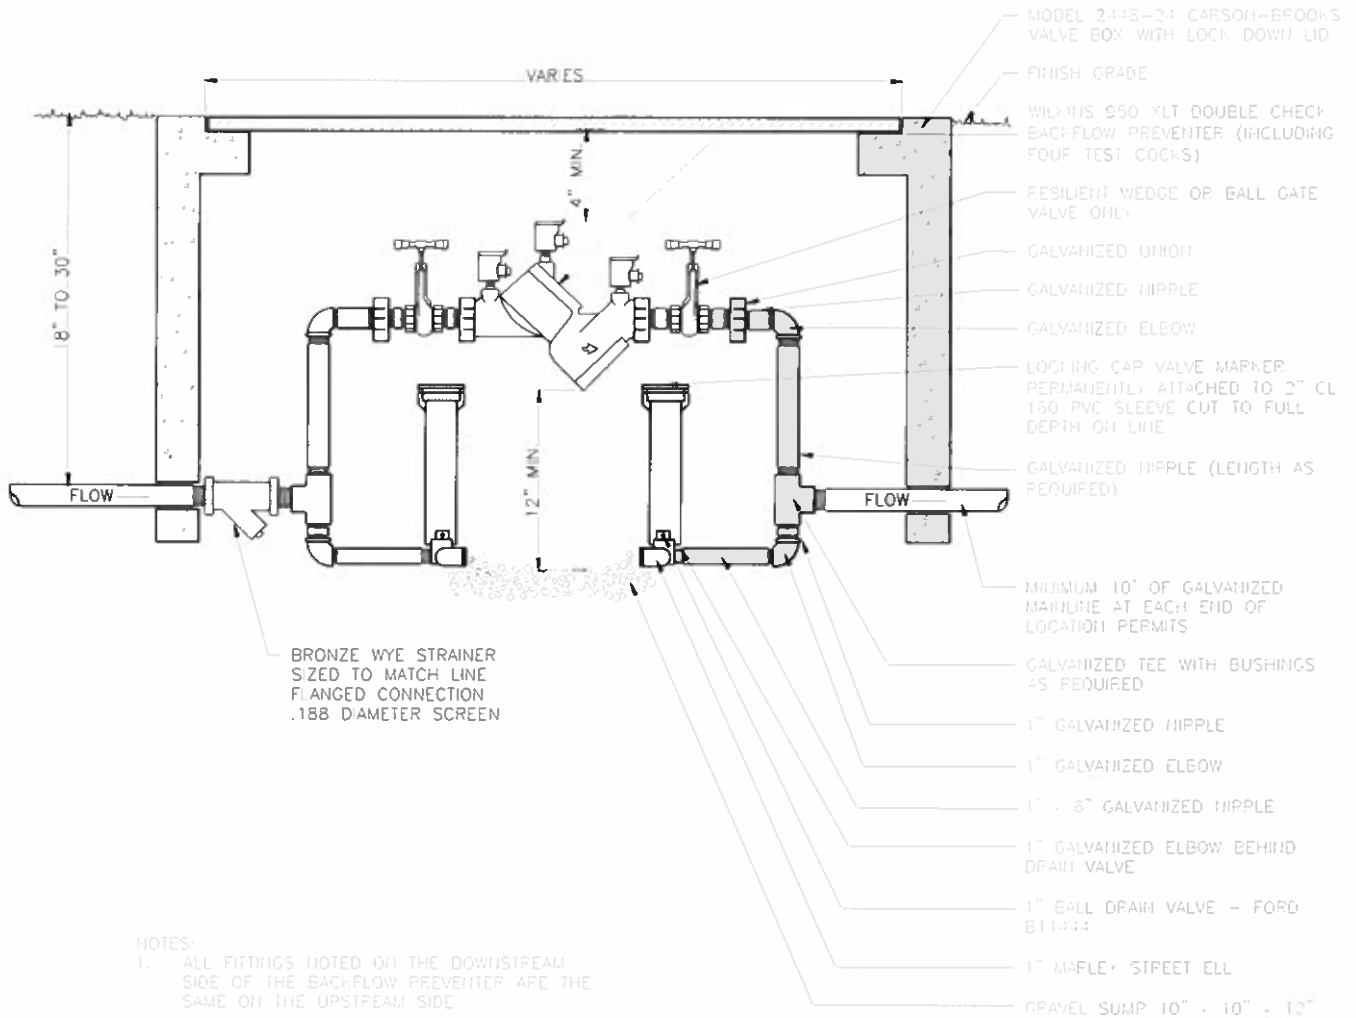

- NOTES:
1. ALL FITTINGS NOTED ON THE DOWNSTREAM SIDE OF THE BACKFLOW PREVENTER ARE THE SAME ON THE UPSTREAM SIDE.
 2. USE BOY EXTENSIONS AS NECESSARY.
 3. VALVE BOY SIZES:
 2" ASSY - MODEL 2443-24
 1 1/2" ASSY - MODEL 2448-24
 1 1/4" ASSY - MODEL 1730-13

DOUBLE CHECK BACKFLOW PREVENTION ASSEMBLY ONLY (2" OR SMALLER SIZES)

HYDE PARK CITY

113 EAST CENTER
 HYDE PARK, UTAH 84318
 TEL: (435) 563-6507



DOUBLE CHECK BACKFLOW PREVENTION ASSEMBLY ONLY (2" OR SMALLER SIZES)

IR-02

DATE: 02-09-21